


GENERAL ELECTRIC
TYPE TMK (1200A
FRAME), OR EQUAL
NEW 3P, 1000A,
240V, ENCL. CKT.
BRKR, NEMA I
ENCL. HANDLE
THRU COVER STYLE.

DELETE ALL REFERENCES
TO NEW 3P, 600A, TYPE MA
BRKR. FOR PANEL "MDP"

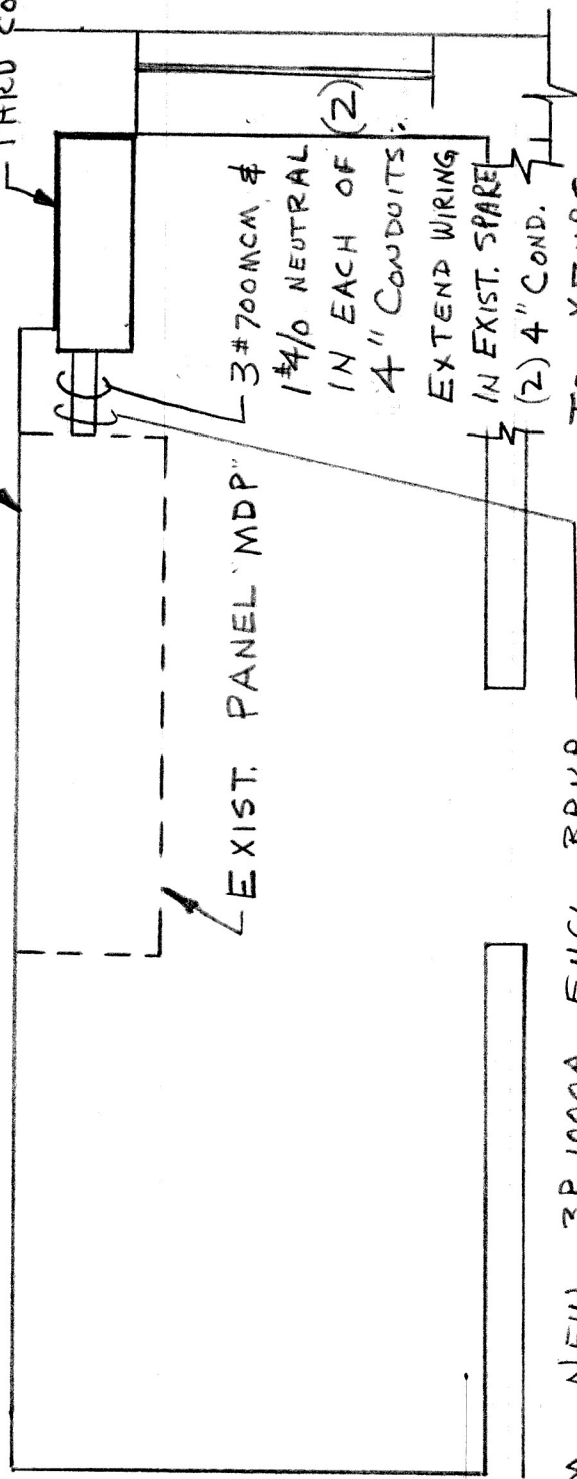

TO XFMRS.
DELETE ALL REFERENCES
TO NEW 4# 250MCM IN
EACH OF (2) EXIST.
SPARE 4" C.

FROM NEW 3P, 1000A ENCL. BRKR.
PROVIDE (2) 3" CONDUITS TO EXIST
SPARE (2) 3" CONDUITS ABOVE PANEL "MDP".
PROVIDE (1) ADDITIONAL 3" CONDUIT FROM
NEW 3P, 1000A ENCL. BRKR. TO PANEL "MP"
IN ROOM 160. RUN 3# 350MCM & 1# 2/0
NEUTRAL IN EACH OF THESE (3) 3" CONDUITS
FROM NEW 3P, 1000A ENCL. BRKR TO PANEL "MP", ROOM 160.
DELETE ALL REFERENCES TO 8# 250 MCM RUN FROM
"MDP" TO "MP".

EXISTING ROOM 7
SCALE: 1/2" = 1'-0"

JOB NO. _____
CLARK, NEXSEN & OWEN
ARCHITECTS & ENGINEERS
COMPUTATIONS SHEET

REVISIONS IN SERVICE TO
GUGG ENHEIMER HOSPITAL
PANEL "MP"

COMPUTED BY: JCH
CHECKED BY: _____
DATE: 6-12-1968

- ARCHITECTURAL
- STRUCTURAL
- CIVIL
- MECHANICAL
- ELECTRICAL