



PANELBOARD SCHEDULE

DESCRIPTION	CIRCUIT BREAKER NUMBER	WIRE RATING	WIRE SIZE	LOAD
PANEL "LA" 120/240V, 1P, 3W, 5/8" FLUSH MTD. 2" MOUNTING BRACKET GROUND BAR.	1	1P, 15A	#12	LIGHTING - FIRST FLOOR
	3	1P, 20A	#10	LIGHTING - FIRST FLOOR
	5	1P, 20A	#10	LIGHTING - SECOND FLOOR
	7	1P, 20A	#10	LIGHTING - SECOND FLOOR
	9	1P, 20A	#10	EXIT LIGHTING
	11	1P, 20A	#10	SPARE
	13	1P, 15A	#12	SPARE
	15	1P, 15A	#12	SPARE
	17	1P, 15A	#12	SPARE
	19	1P, 15A	#12	SPARE
	21	1P, 15A	#12	SPARE
	23	1P, 15A	#12	SPARE
	25	1P, 15A	#12	SPARE
	27	1P, 15A	#12	SPARE
	29	1P, 15A	#12	SPARE
	31	1P, 15A	#12	SPARE
	33	1P, 15A	#12	SPARE
	35	1P, 15A	#12	SPARE
	37	1P, 15A	#12	SPARE
	39	1P, 15A	#12	SPARE
	41	1P, 15A	#12	SPARE
	2	1P, 20A	#10	LIGHTING - THIRD FLOOR
	4	1P, 20A	#10	LIGHTING - THIRD FLOOR
	6	1P, 20A	#10	RECEPTACLES - FIRST FLOOR
	8	1P, 20A	#10	RECEPTACLES - SECOND FLOOR
	10	1P, 20A	#10	RECEPTACLES - THIRD FLOOR
	12	1P, 20A	#10	SPARE
	14	1P, 15A	#12	SPARE
	16	1P, 15A	#12	SPARE
	18	1P, 15A	#12	SPARE
	20	1P, 15A	#12	SPARE
	22	1P, 15A	#12	SPARE
	24	1P, 15A	#12	SPARE
	26	1P, 15A	#12	SPARE
	28	1P, 15A	#12	SPARE
	30	1P, 15A	#12	SPARE
	32	1P, 15A	#12	SPARE
	34	1P, 15A	#12	SPARE
	36	1P, 15A	#12	SPARE
	38	1P, 15A	#12	SPARE
	40	1P, 15A	#12	SPARE
	42	1P, 15A	#12	SPARE

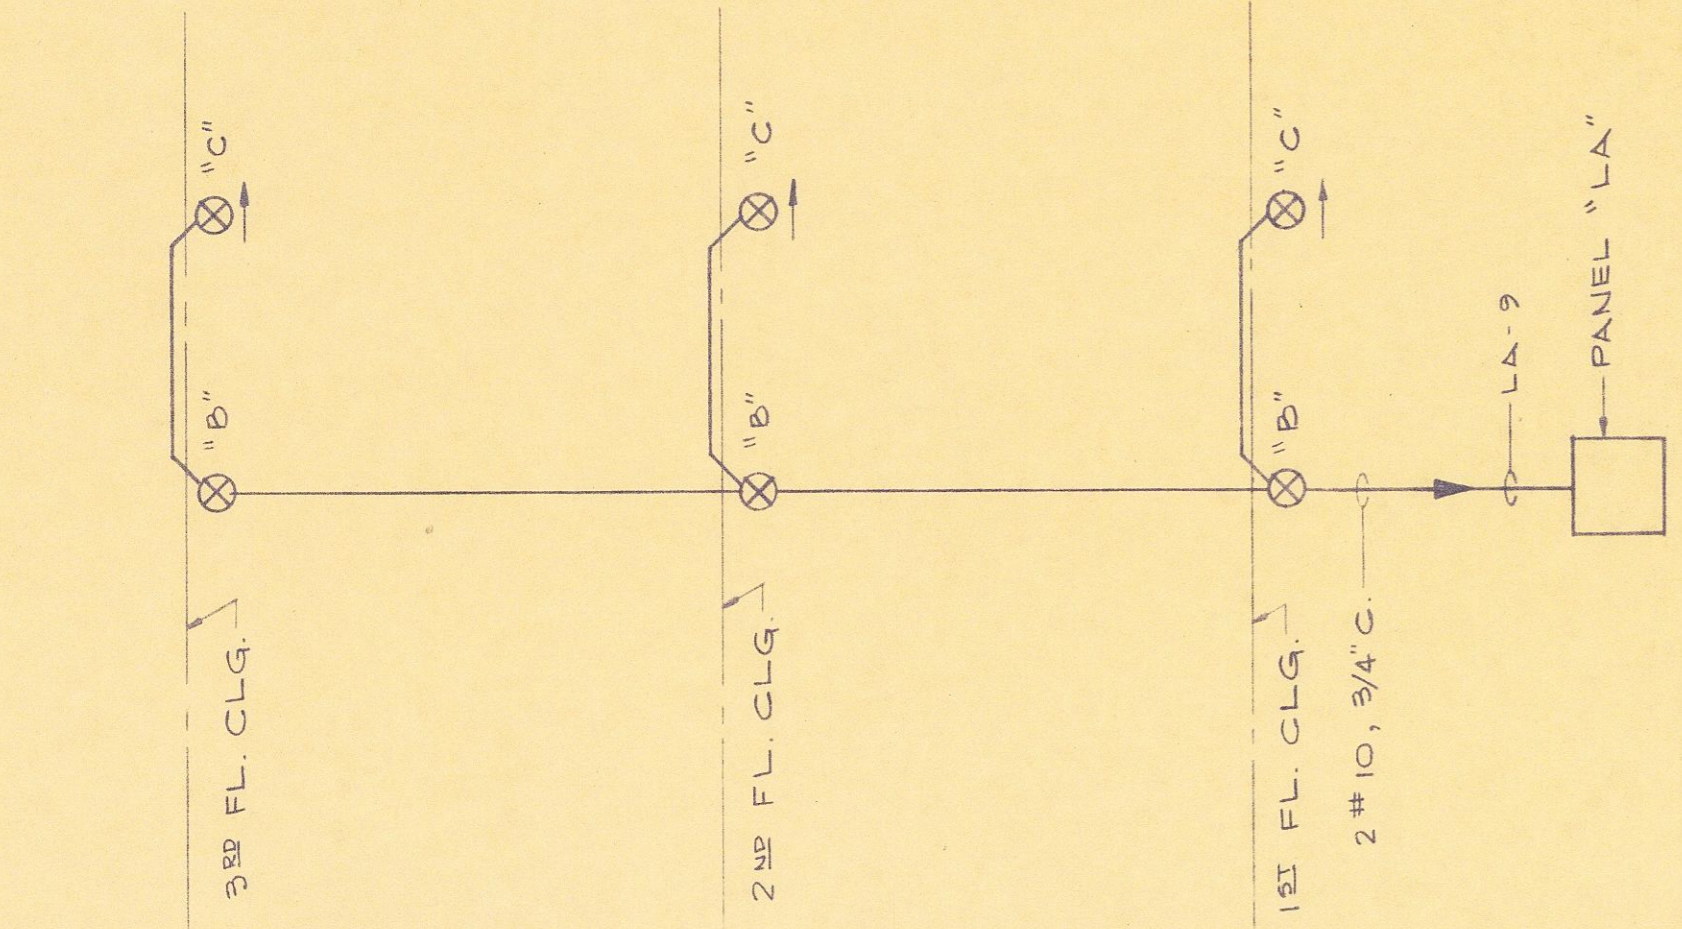


NOTE  
SEE PLANS FOR PANELBOARDS &  
FIXTURE LOCATIONS.

EXIT LIGHT RISER DIAGRAM  
NO SCALE

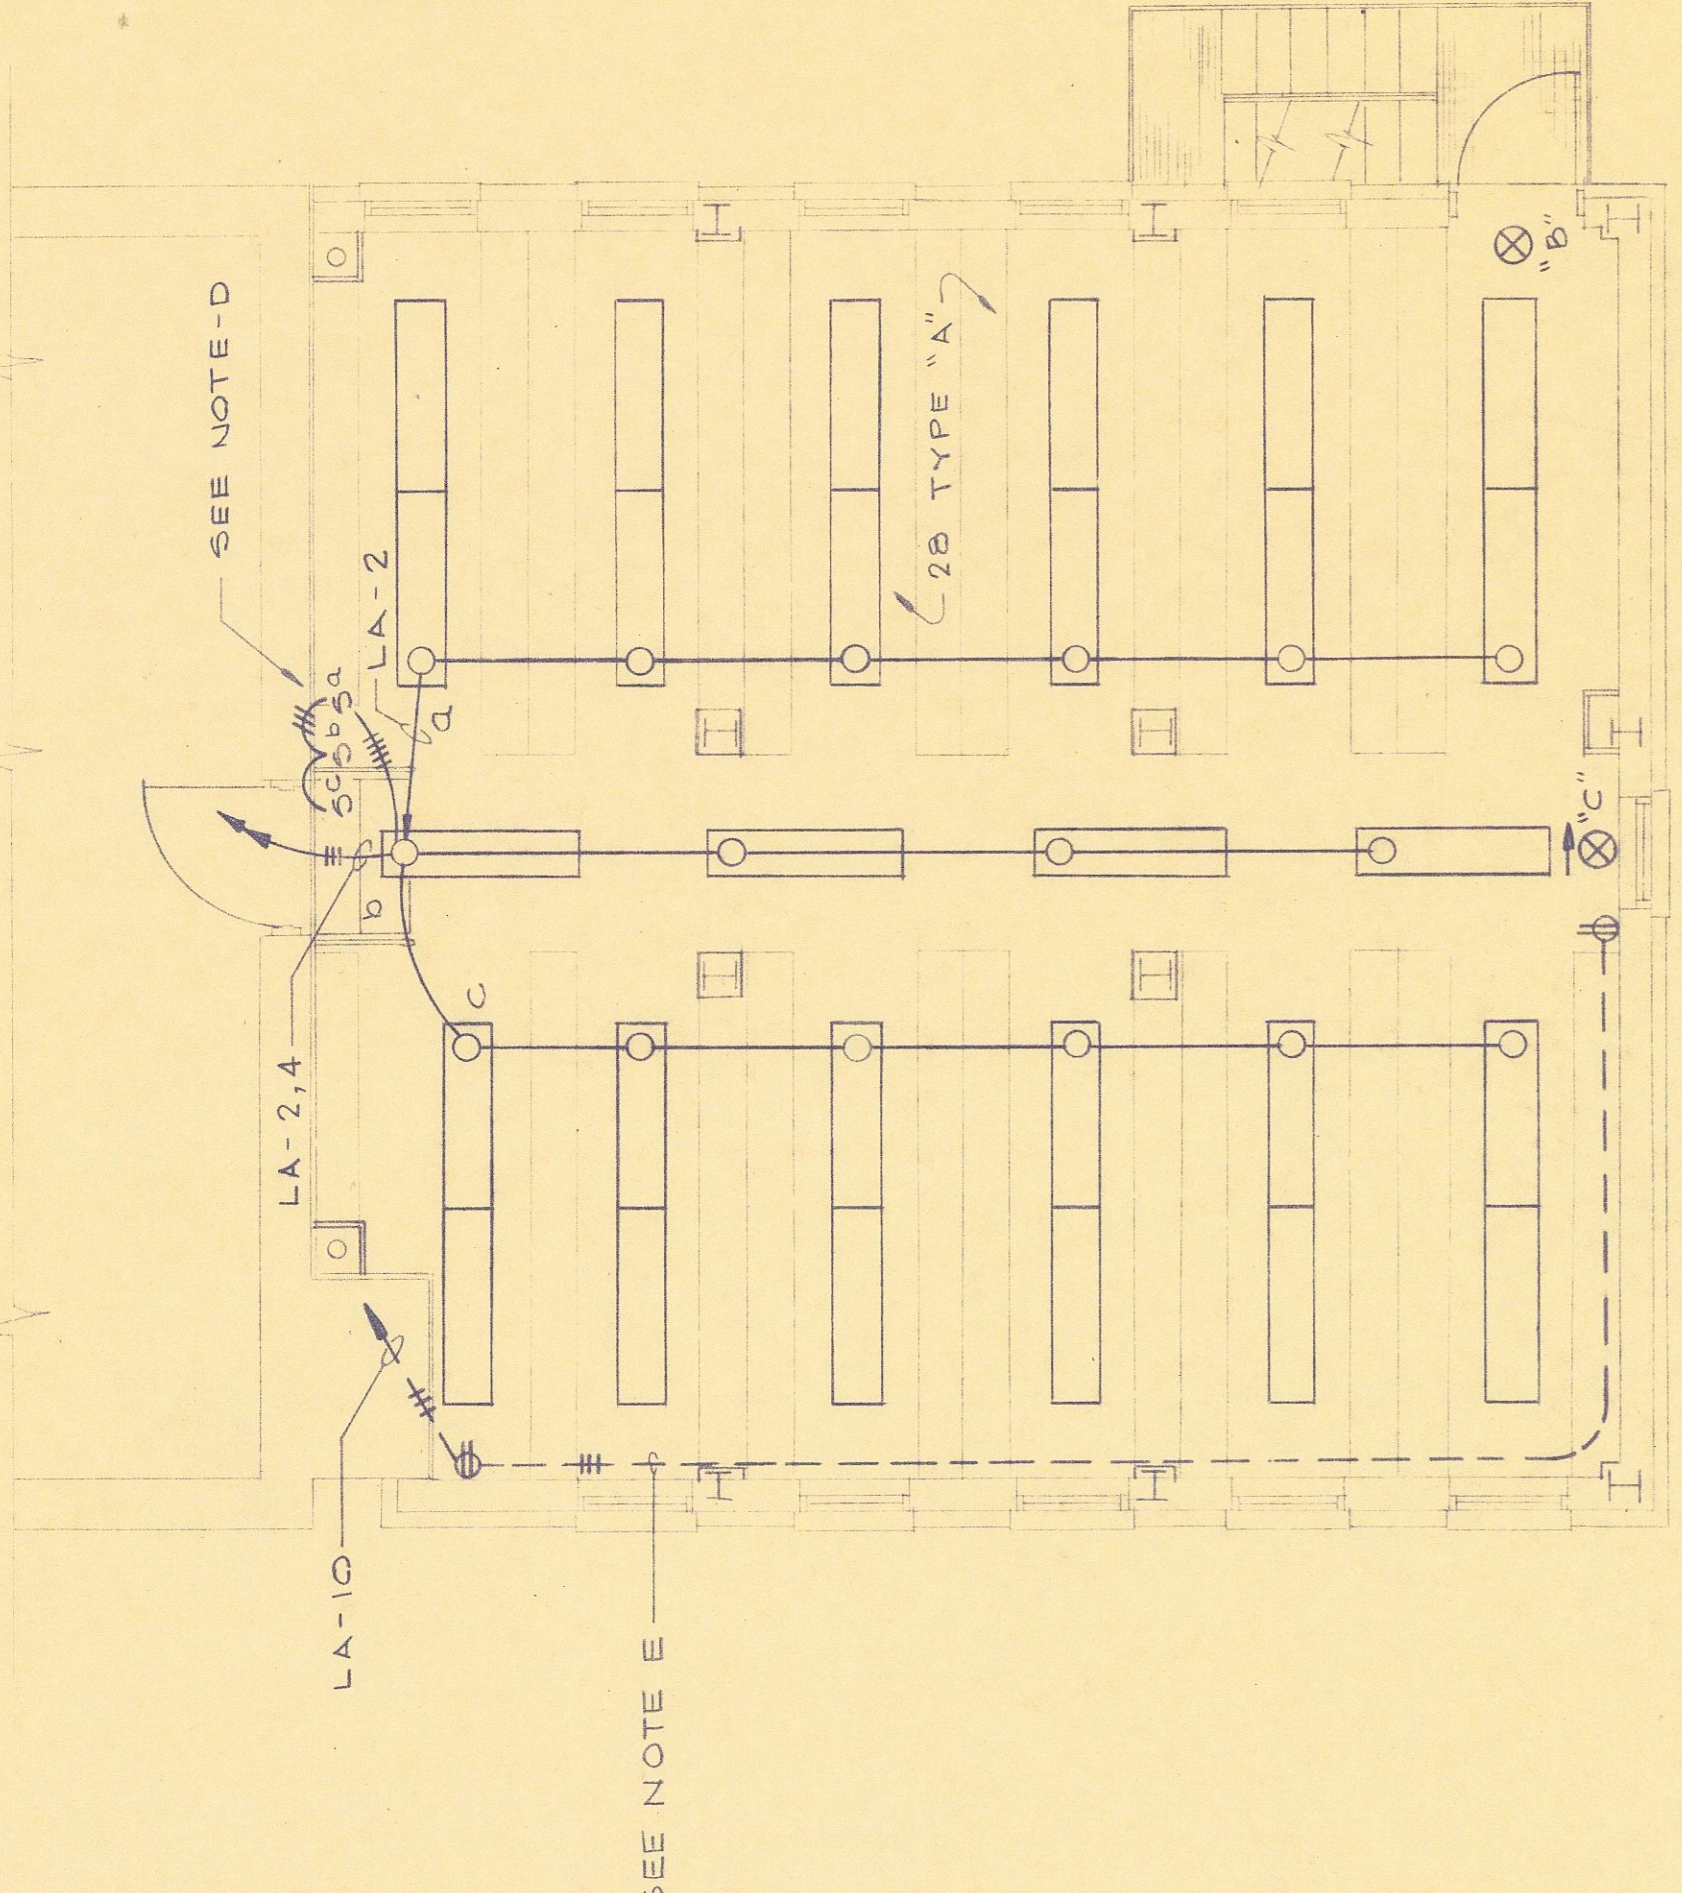

THIRD FLOOR PLAN  
SCALE: 1/4" = 1'-0"

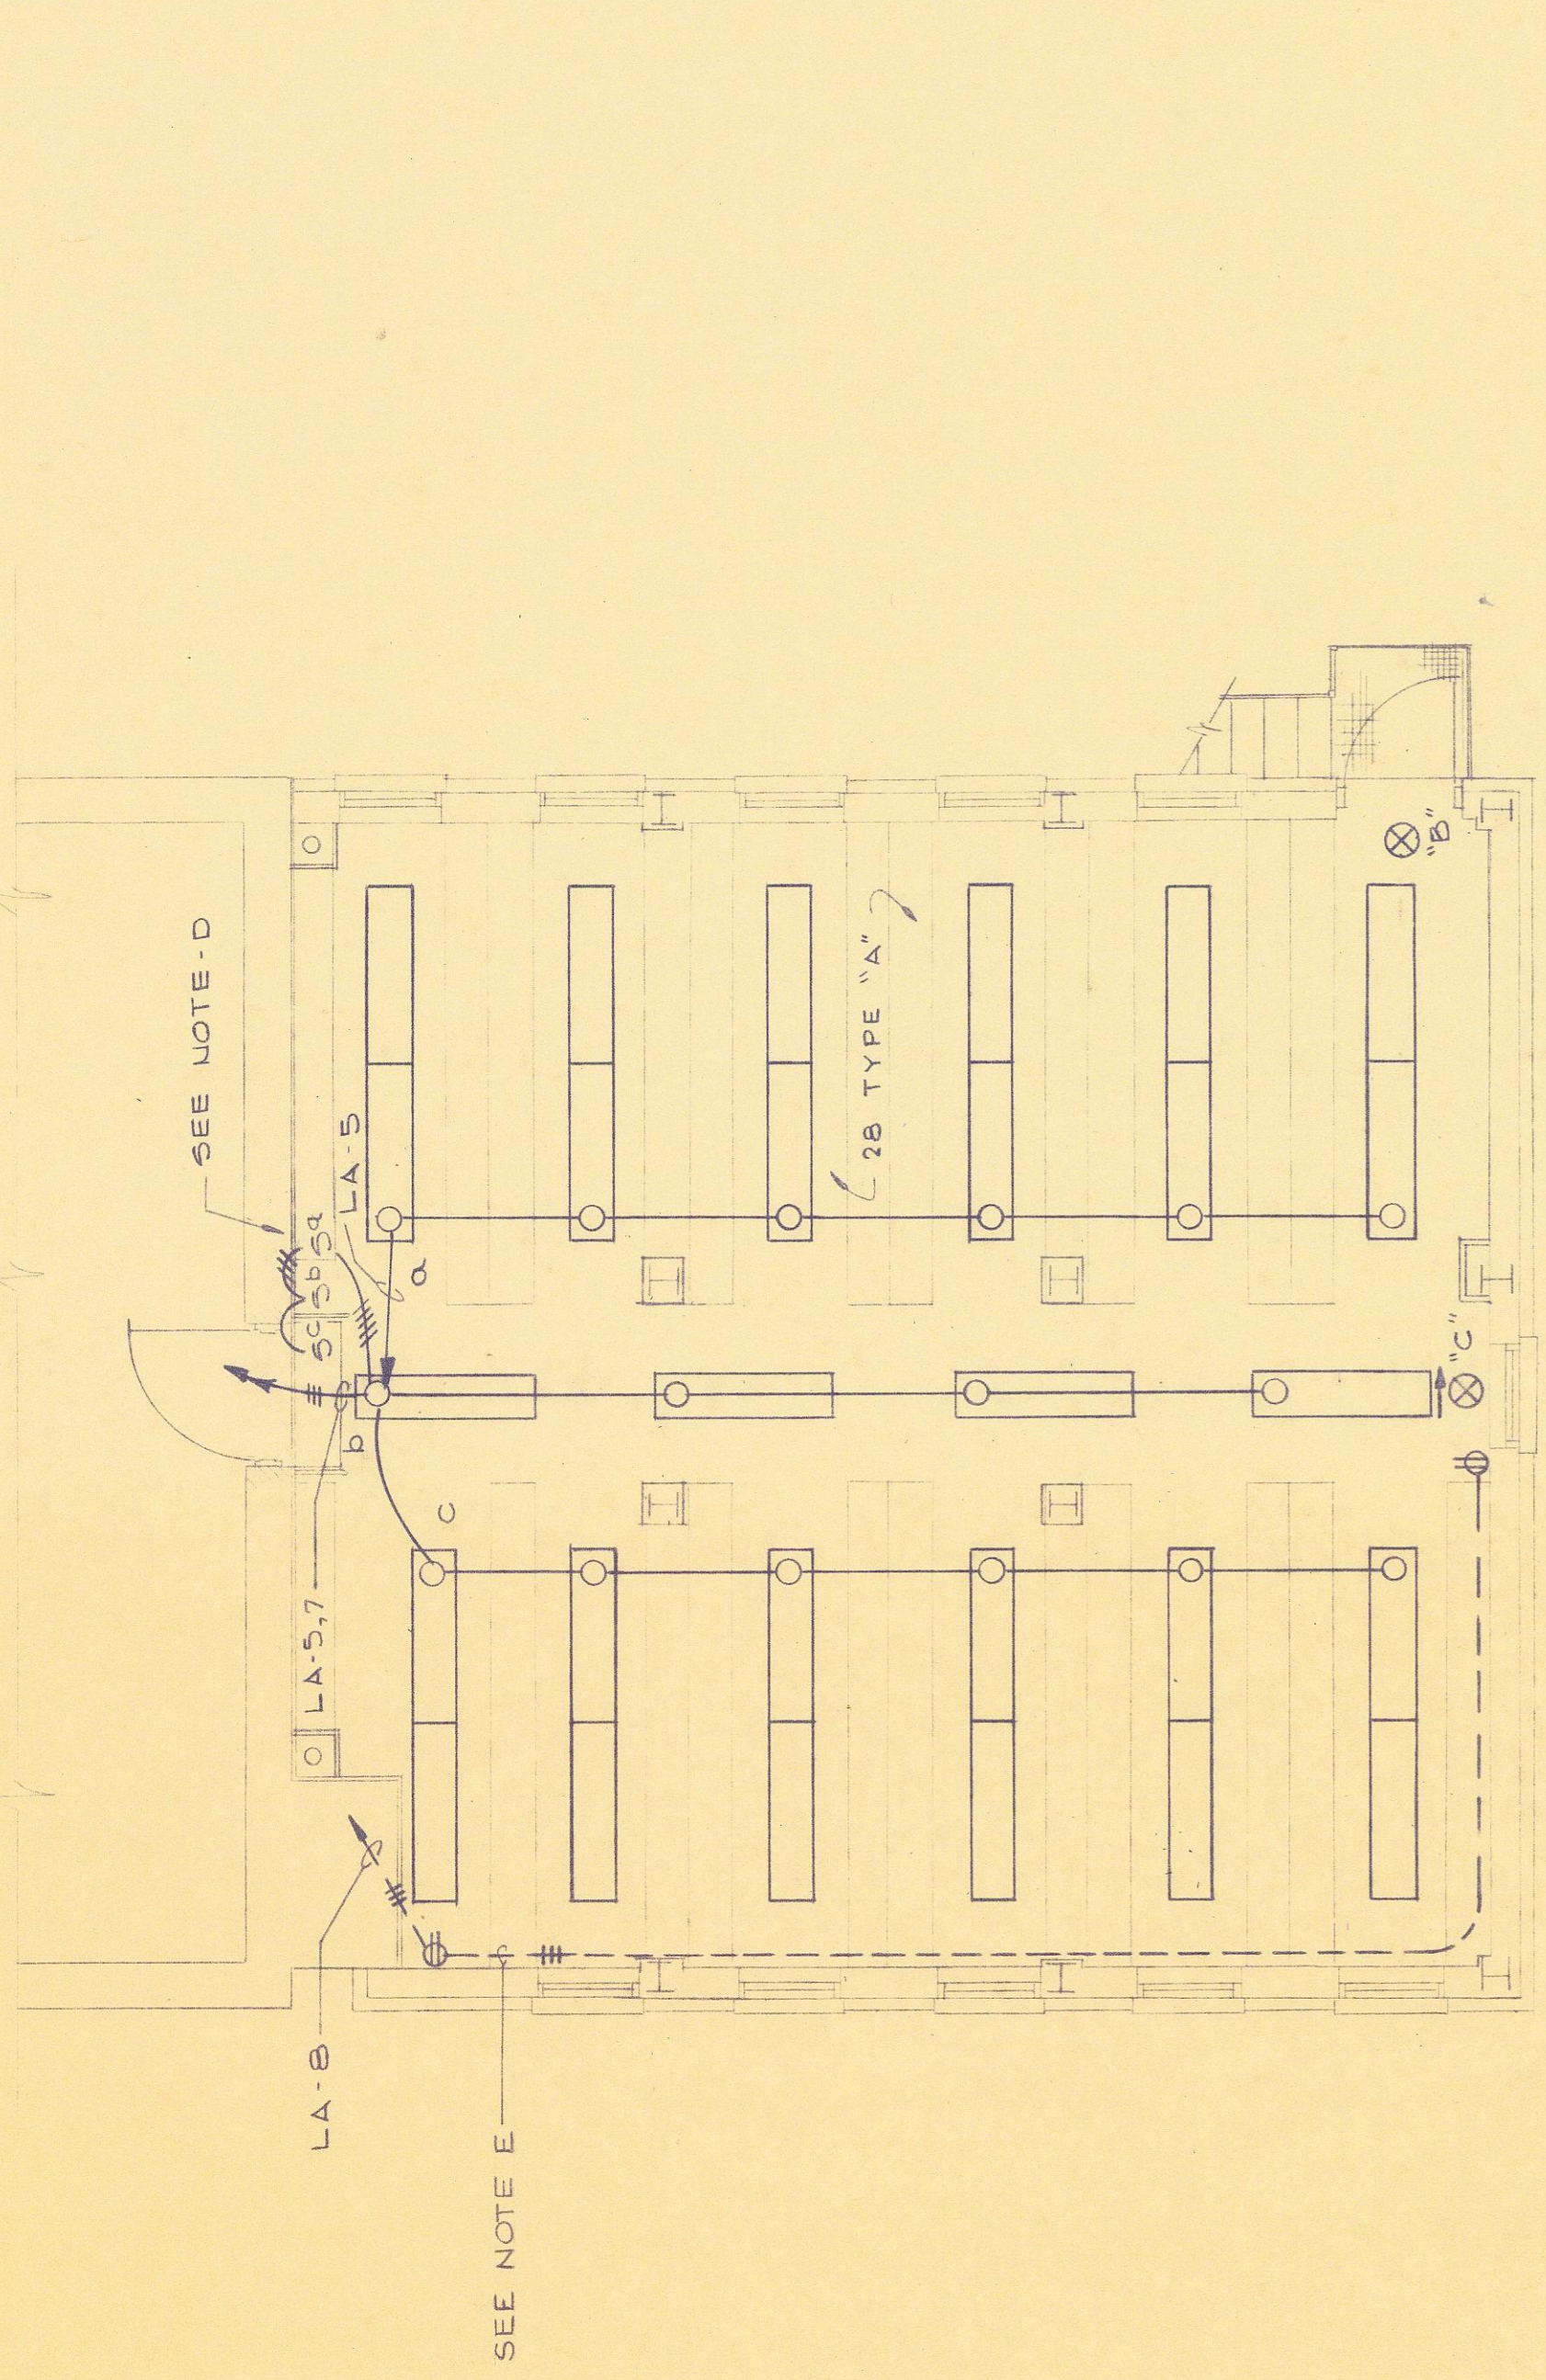

SECOND FLOOR PLAN  
SCALE: 1/4" = 1'-0"

LEGEND


- FLUORESCENT LIGHTING FIXTURE - SEE FIXTURE SCHEDULE
- ⊗ EXIT LIGHTING FIXTURE - SEE FIXTURE SCHEDULE
- RECEPTACLE
- MINIMUM WIRE SIZE #12 AWG
- RECONNECT ALL WIRING FROM EXIST. PANEL TO NEW PANEL "LA"
- SWITCHES IN 2" GAUGE OUTLET BOX ON EXIST. WALL AS SHOWN MOUNT 4" UP FROM EXIST. FLOOR LEVEL
- GROUND WIRE SHOWN IN BRANCH CIRCUITS
- WIRING & CONDUIT ROUTING ARE SHOWN FOR DIAGRAMATIC PURPOSES ONLY. EXACT ROUTING TO BE DETERMINED ON LOCATION.
- PANEL "LA"
- CIRCUIT "10"

GENERAL NOTES


- A. COORDINATE LOCATION & INSTALLATION OF ALL LIGHTING FIXTURES WITH OTHER TRADES PRIOR TO SETTING OF OUTLETS, CEILING SYSTEMS, ETC.
- B. MINIMUM WIRE SIZE #12 AWG
- C. RECONNECT ALL WIRING FROM EXIST. PANEL TO NEW PANEL "LA"
- D. SWITCHES IN 2" GAUGE OUTLET BOX ON EXIST. WALL AS SHOWN MOUNT 4" UP FROM EXIST. FLOOR LEVEL
- E. GROUND WIRE SHOWN IN BRANCH CIRCUITS
- F. WIRING & CONDUIT ROUTING ARE SHOWN FOR DIAGRAMATIC PURPOSES ONLY. EXACT ROUTING TO BE DETERMINED ON LOCATION.

FIXTURE SCHEDULE

TYPE	MANUFACTURER	CATALOG NO.	NO. & SIZE LAMPS	MOUNTING	REMARKS
A	MILLER	OW 201-04	2/40 MR5	SURFACE CLG.	
B	PERECLITE	P5-B71	2/25 WIF	SURFACE CLG.	
C	PERECLITE	P5-B71-E	2/25 WIF	SURFACE CLG.	

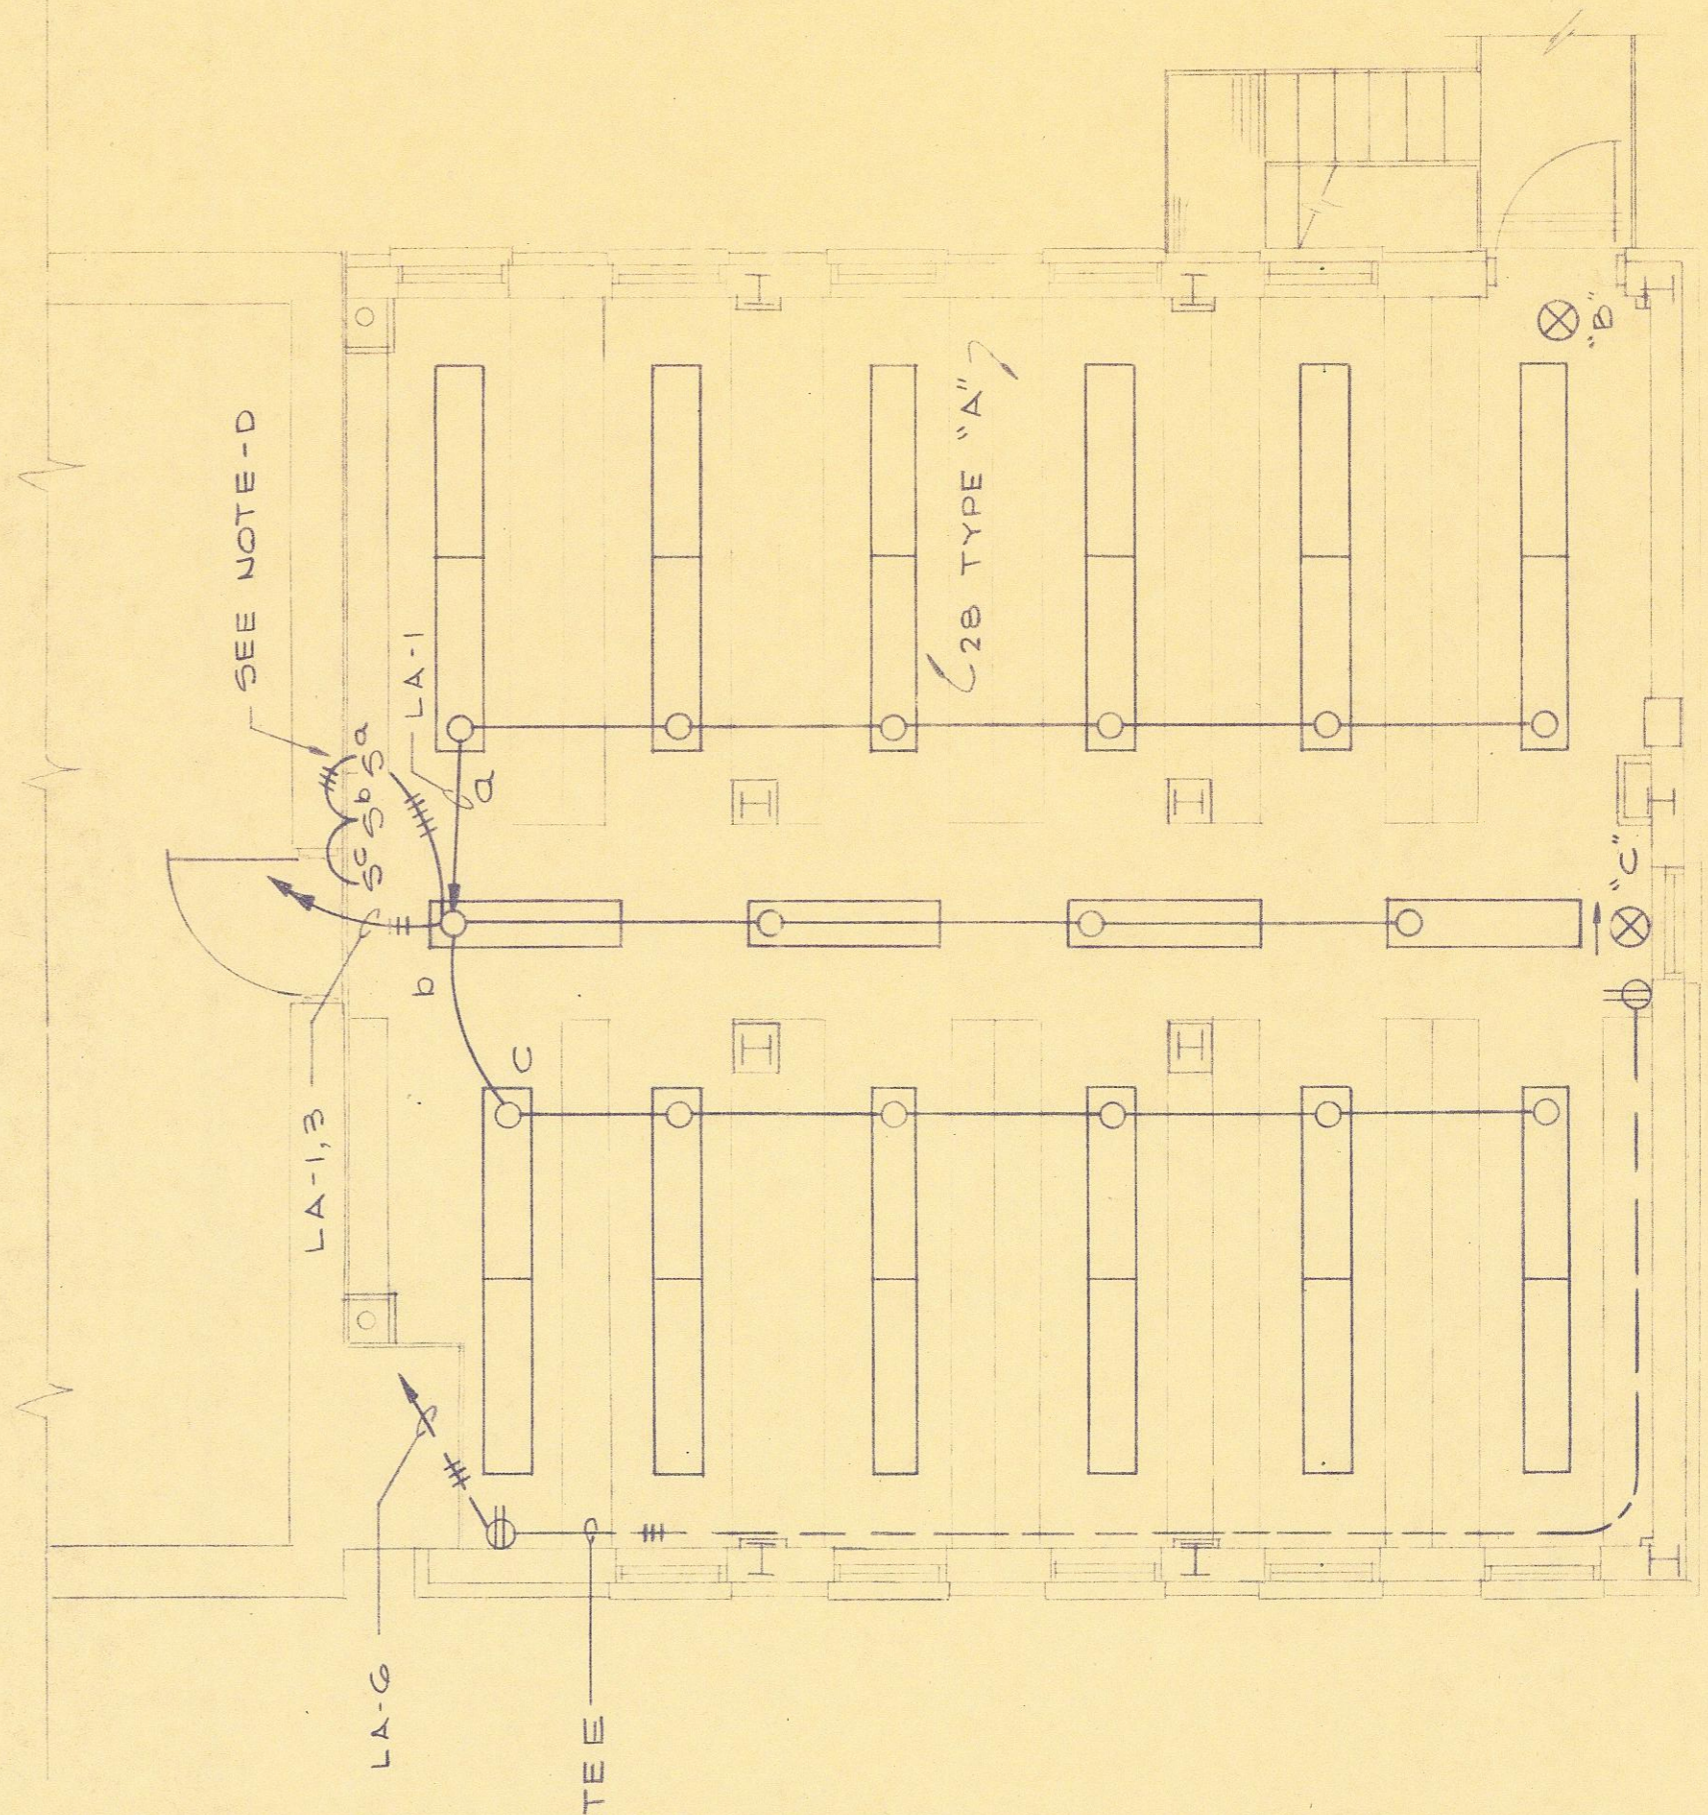

FIRST FLOOR PLAN  
SCALE: 1/4" = 1'-0"

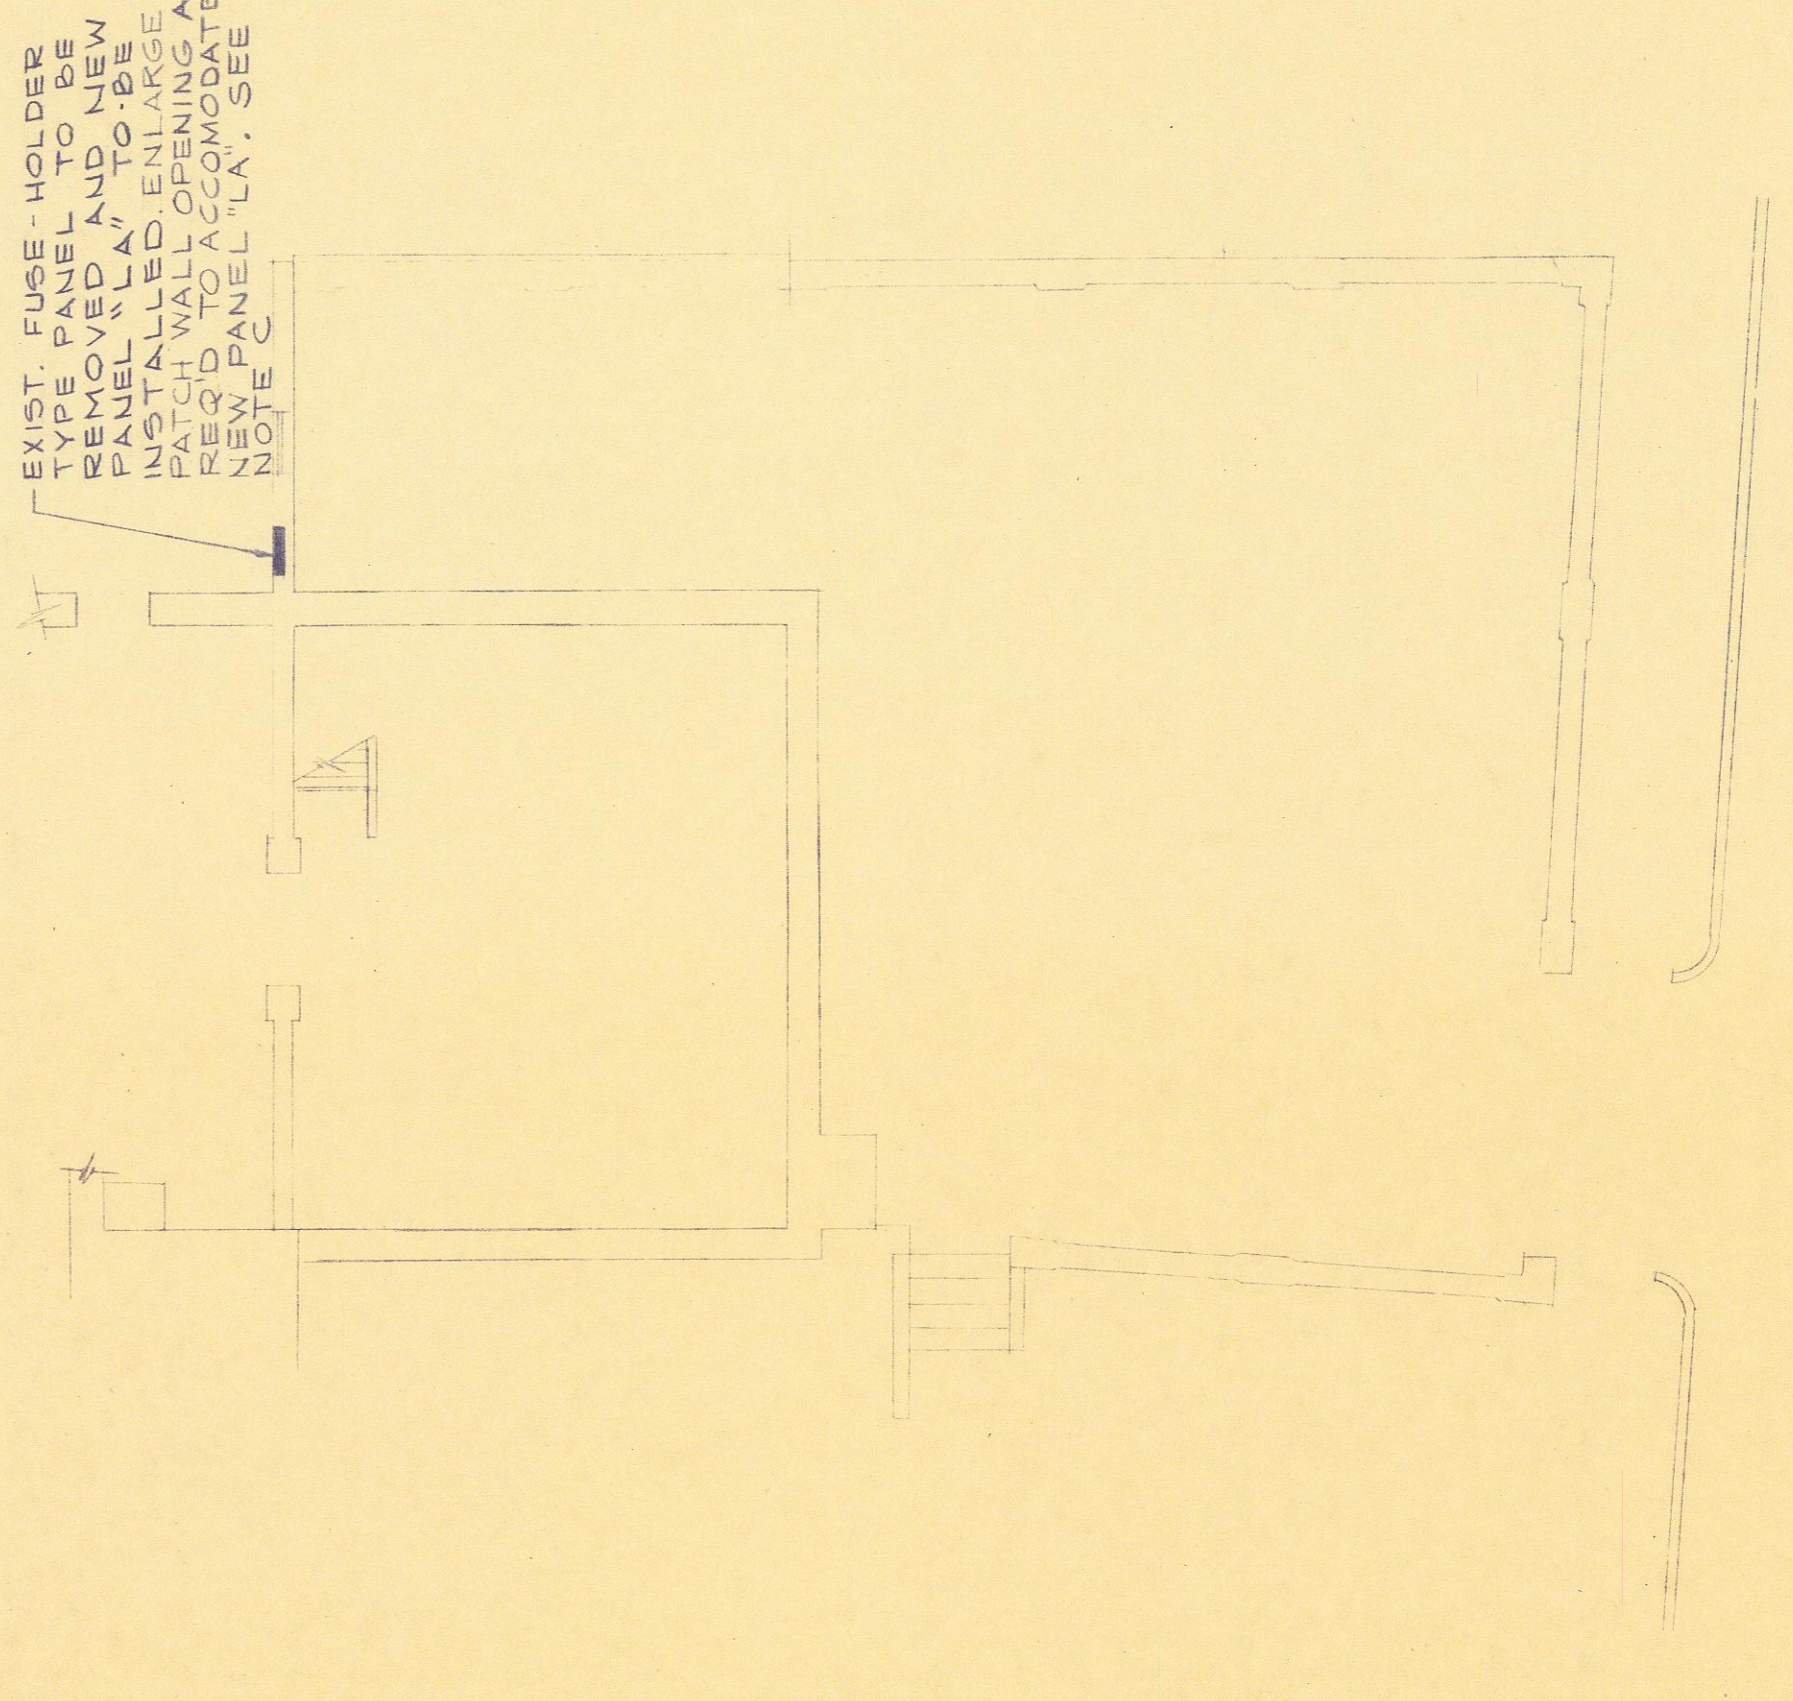

EXISTING FIRST FLOOR PLAN  
SCALE: 1/8" = 1'-0"

