



SECOND FLOOR PLAN
SCALE: 1/8" = 1'-0"

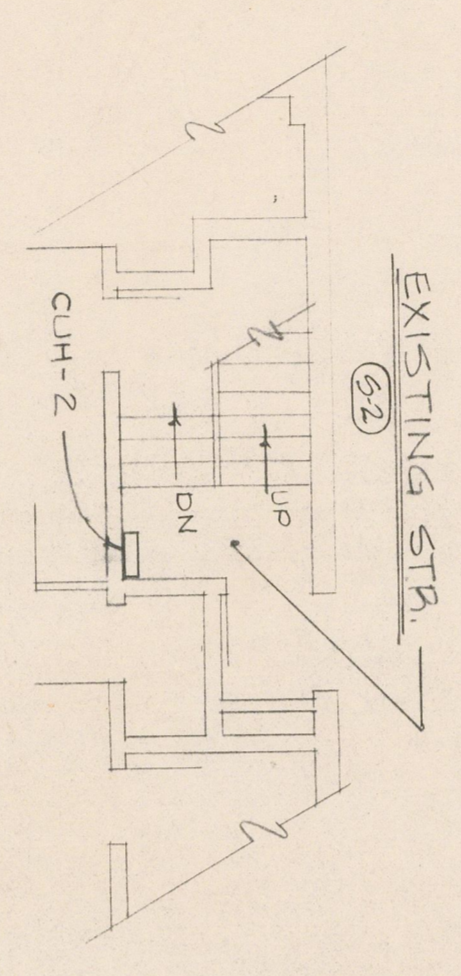

PART FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
[Symbol]	SUPPLY DUCT	[Symbol]	STAINLESS STEEL WITH WOODGRASS
[Symbol]	RETURN DUCT	[Symbol]	STEAM TRAP
[Symbol]	FRESH AIR DUCT	[Symbol]	FLAM CONTROL VALVE
[Symbol]	EXHAUST DUCT	[Symbol]	CHECK VALVE
[Symbol]	INCLINED DUCT IN ROOM	[Symbol]	WATERSTOP VALVE
[Symbol]	APPROXIMATELY LINED DUCT	[Symbol]	DOWN WATER
[Symbol]	FLATFIELD CONNECTION IN DUCT	[Symbol]	PRESSURE GAUGE
[Symbol]	SIGNAL DIFFUSER	[Symbol]	RELIEF VALVE
[Symbol]	RETURN GRILLE	[Symbol]	CONSTANT LOW CONTROL, WATER-CAP.
[Symbol]	DOOR LOCKER	[Symbol]	COLD VALVE
[Symbol]	GRILLE TYPE	[Symbol]	AUTOMATIC VALVE--WAY
[Symbol]	WATERSTOP DAMPER	[Symbol]	MANUAL VALVE--WAY
[Symbol]	MANUAL DAMPER	[Symbol]	PIPE ANCHOR
[Symbol]	FLATFIELD DUCT	[Symbol]	FLAM INDICATOR
[Symbol]	MANUAL AIR VENT	[Symbol]	THERMISTOR
[Symbol]	THERMISTOR	[Symbol]	ELECTRICAL DISPERSED RADIATION
[Symbol]	SHORT STACK THERMOSTAT	[Symbol]	HOT WATER SUPPLY
[Symbol]	RECIPIENT THERMOSTAT	[Symbol]	HOT WATER RETURN
[Symbol]	WATER-UP THERMOSTAT	[Symbol]	CHILLED WATER RETURN
[Symbol]	SHORT PAK SPEED CONTROL	[Symbol]	CHILLED WATER SUPPLY
[Symbol]	THERMISTAT/WATERSTOP COMBINATION	[Symbol]	OIL SUPPLY
[Symbol]	MANUAL VALVE	[Symbol]	OIL RETURN
[Symbol]	STEAM	[Symbol]	FUEL OIL RETURN
[Symbol]	FRESH AIR SUPPLY	[Symbol]	FUEL OIL RETURN
[Symbol]	STEAM CONDENSATE	[Symbol]	RECIPROCAT VAPOR
[Symbol]	CONDENSATE DRAIN	[Symbol]	RECIPROCAT VAPOR
[Symbol]	FIRE UP	[Symbol]	RECIPROCAT LIQUID
[Symbol]	FIRE DOWN	[Symbol]	RECIPROCAT LIQUID
[Symbol]	GATE VALVE	[Symbol]	RECIPROCAT DISCHARGE
[Symbol]	FLATFIELD PIPE	[Symbol]	DIS
[Symbol]	WATER	[Symbol]	OMNIZONE THERMISTAT
[Symbol]	CAPPED PIPE	[Symbol]	VARIABLE AIR VOLUME DAMPER
[Symbol]	CONNECT TO EXISTING		

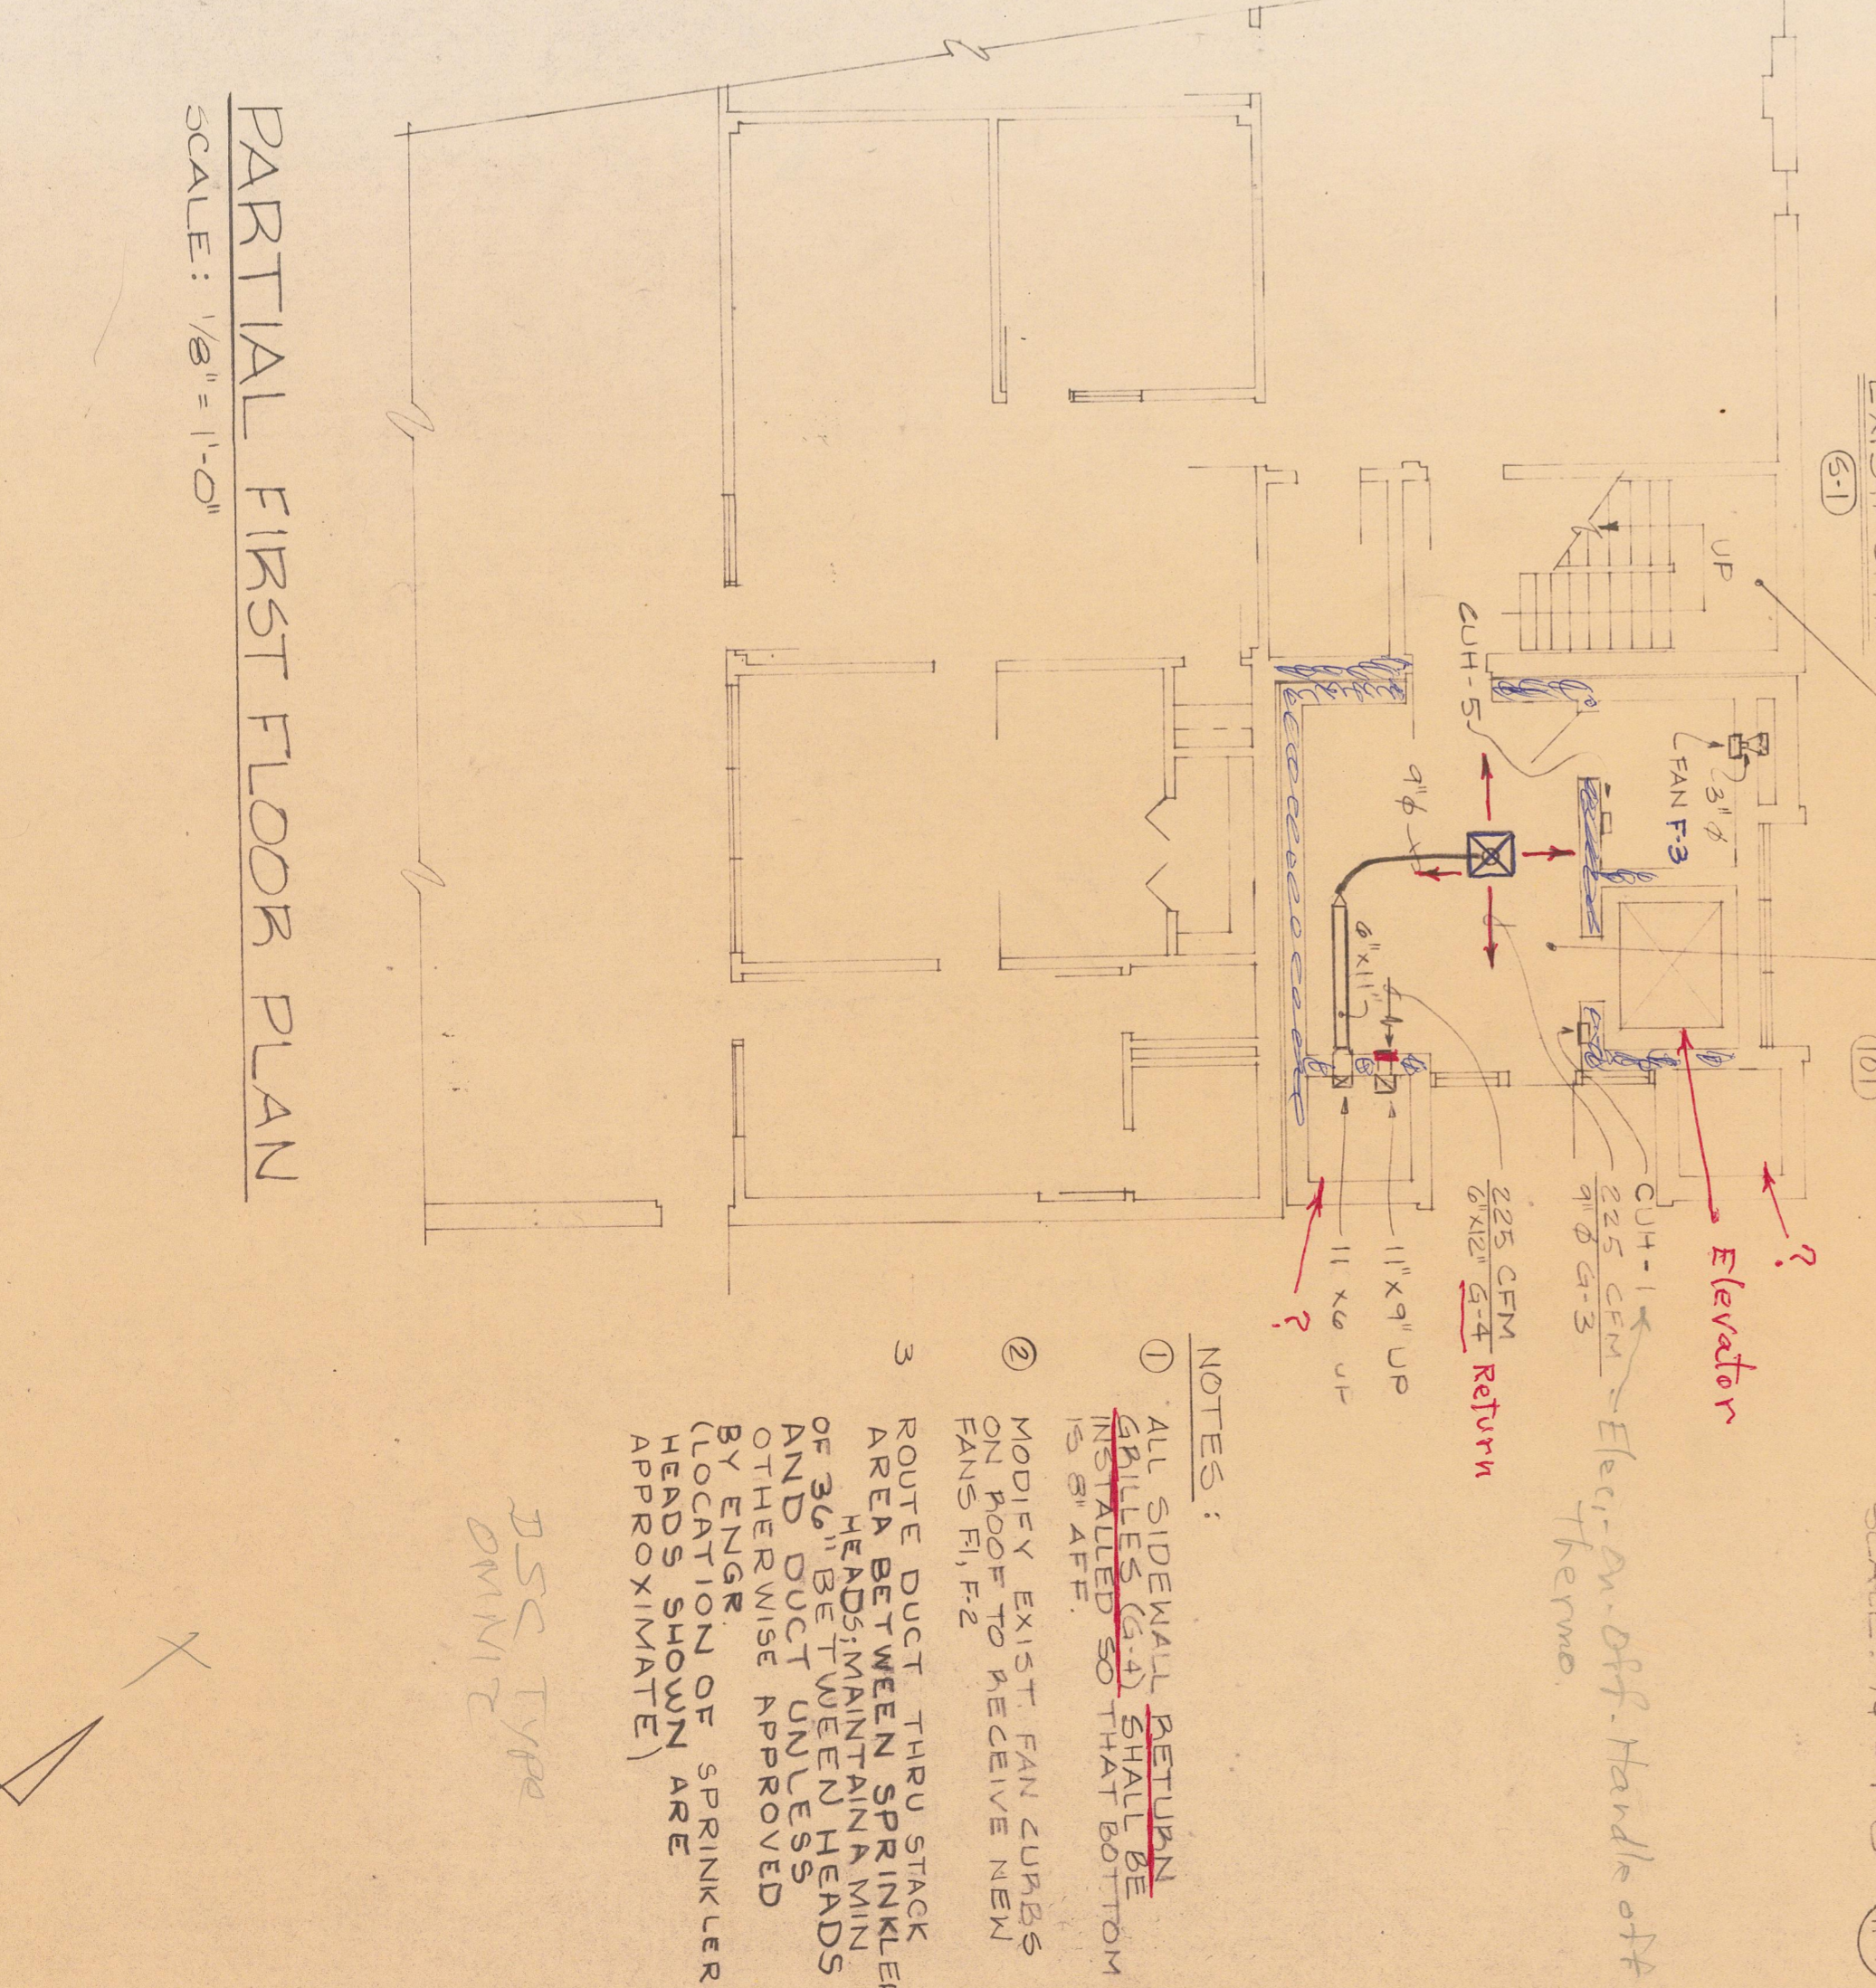

PARTIAL FIRST FLOOR PLAN
SCALE: 1/8" = 1'-0"

NOTES:
 1 ALL SIDEWALL RETURN GRILLES (AND) SHALL BE INSTALLED SO THAT BOTTOM IS AT FT.
 2 MODIFY EXIST FAN CURVES AND SPEEDS TO MATCH NEW FAN CURVES.
 3 ROUTE DUCT THRU STACK AREA BETWEEN SPRINKLER HEADS: MAINTAIN MIN. 36" CLEARANCE BETWEEN SPRINKLER HEADS: APPROVED BY ENGR. LOCATION OF SPRINKLER HEADS SHOWN ARE APPROXIMATE.

COMMONWEALTH OF VIRGINIA
 EARL K. SIMPSON, JR.
 CONSULTING ENGINEER
 CERTIFICATE NO. 2378

Simpson • Johnson, Inc.
 CONSULTING ENGINEERS
 101 CLAY STREET, LYNCHBURG, VIRGINIA 24504

COMMONWEALTH OF VIRGINIA
 M. LYMAN JOHNSON
 CERTIFICATE NO. 96
 REGISTERED PROFESSIONAL ENGINEER

CLARK • NEXSEN • OWEN • BARBIERI • GIBSON
 Architects • Engineers
 A PROFESSIONAL CORPORATION
 ALLIED ARTS BLDG. BOX 1156 • LYNCHBURG, VA 24505 • 804/847-9081
 740 DUKE STREET / SUITE 200 • NORFOLK, VA 23510 • 804/622-2800

REVISIONS & NOTES
 DATE
 BY
 CHECKED
 DATE
 BY
 DATE
 BY

SCALE: 1/8" = 1'-0"

H-1
 drawing

RELOCATION OF THE
JONES MEMORIAL LIBRARY
 MEMORIAL AVE. & LAKESIDE DR.
 LYNCHBURG, VIRGINIA